

<b>DESCRIPTION: CIVIC CENTRE COOLING SYSTEM REPLACEMENT</b>  <b>RFP #: CAP 7227</b>	<b>ADDENDUM NUMBER:</b> <b>01</b>
	<b>DATE OF ISSUE: 25 JULY 2024</b>
	<b>ISSUED BY: Amy Bernard</b>
	<b>PAGE(S): 2</b>

**INSTRUCTIONS:**


1. Amend your copy of the proposal in accordance with the detail below.
2. Retain one (1) copy for your file; sign a 2nd copy and attach to your submission as confirmation that the Addendum was taken into account in your proposal submission.
3. Failure to sign and attach this form with your submission may result in a non-compliant proposal.

**DETAILS OF ADDENDUM:**

1. Is it permissible to run conduit on the exterior of the building?

**Answer: Bid the electrical as described on the electrical drawings, it is preferable to avoid running conduit on the outside of the building.**

2. Is this a block-wall behind the drywall?

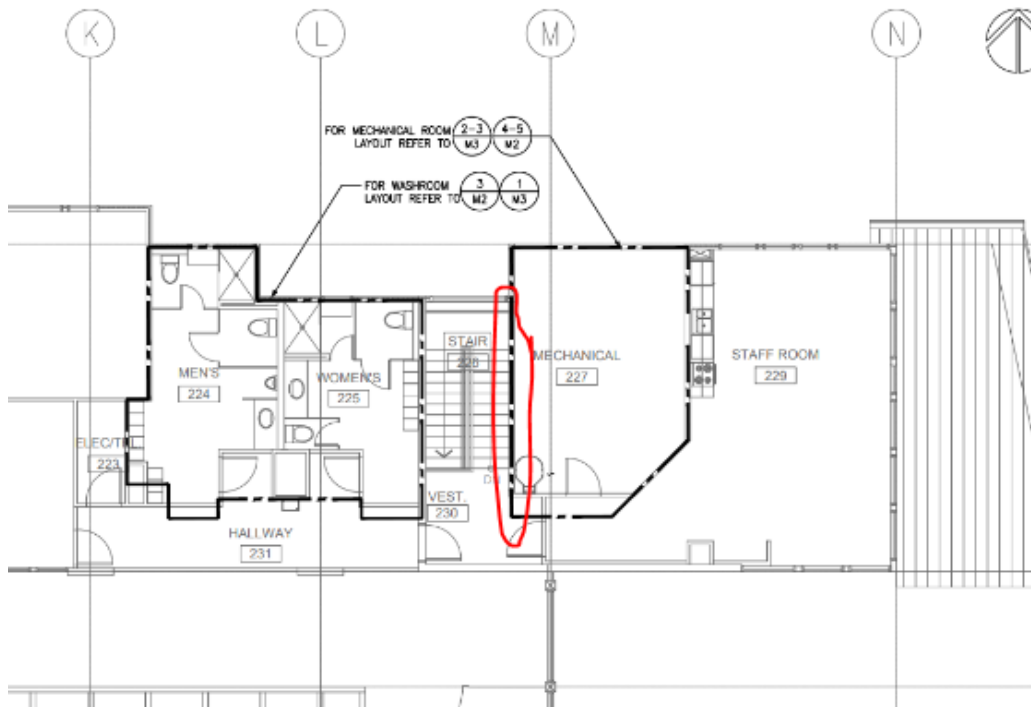

**Answer: Due to ratings, assume it is concrete block.**



3. What is the size of the chiller in the design?

Answer: The chiller was spec'd a few years ago and there are mandated refrigerant changes, but as for the specific spec, it's a 60ton chiller, but when its derated for high altitude and the glycol in the system, it ends up being a 72 ton chassis.

**Name of Firm**

**Authorized Signature**

**Printed Name**

---

---

---

**Date**

---